


NOTE: THE 2" PVC PIPE CONDUIT SHALL BE PLACED 24-INCHES TO 30-INCHES BELOW FINISHED EARTH GRADE. CONDUIT SHALL BE LAID FROM CENTER OF POLE OR AS DIRECTED BY THE ENGINEER.

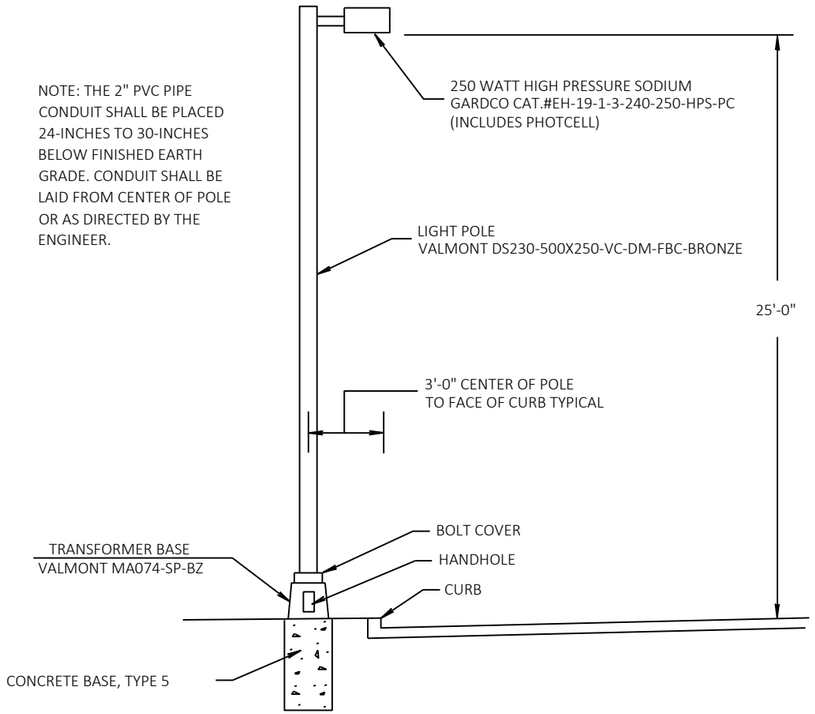



LIGHT POLE DETAIL

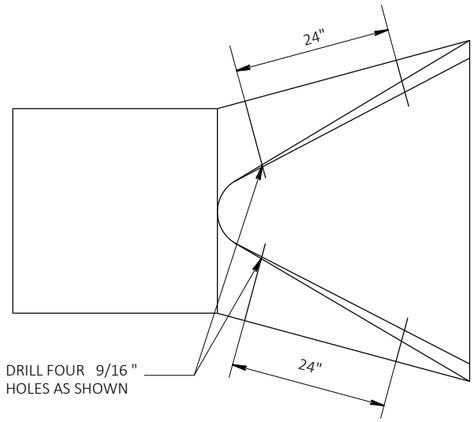


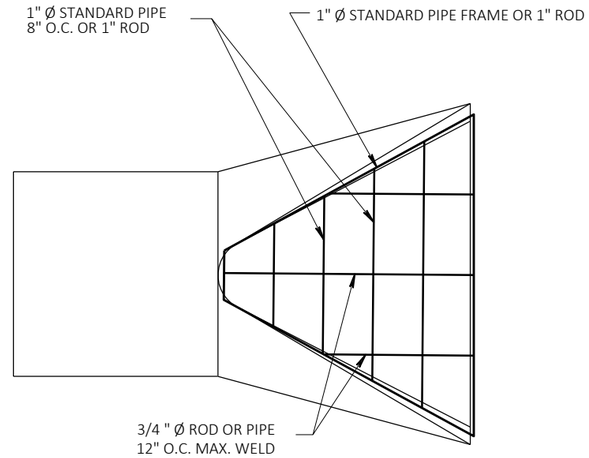

AT EACH PIPE

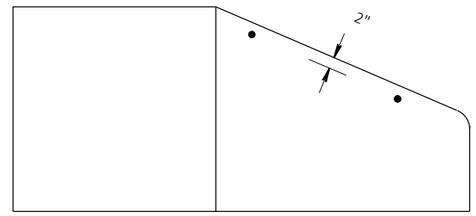

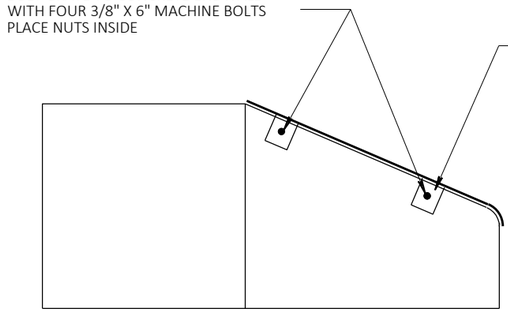

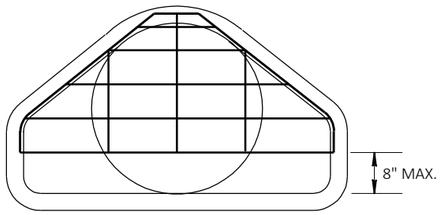

PIPE GRATE DETAIL